

# ioLogik E4200

## Quick Installation Guide

---

Modular Ethernet Remote I/O Adapter

Edition 4.0, December 2016

### Technical Support Contact Information

[www.moxa.com/support](http://www.moxa.com/support)

Moxa Americas:

Toll-free: 1-888-669-2872

Tel: 1-714-528-6777

Fax: 1-714-528-6778

Moxa China (Shanghai office):

Toll-free: 800-820-5036

Tel: +86-21-5258-9955

Fax: +86-21-5258-5505

Moxa Europe:

Tel: +49-89-3 70 03 99-0

Fax: +49-89-3 70 03 99-99

Moxa Asia-Pacific:

Tel: +886-2-8919-1230

Fax: +886-2-8919-1231

Moxa India:

Tel: +91-80-4172-9088

Fax: +91-80-4132-1045

**MOXA®**


© 2016 Moxa Inc. All rights reserved.

P/N: 1802042000013



## Introduction

The ioLogik E4200 comes equipped with 2 Ethernet ports and 1 RS-232 port, making it suitable for remote monitoring and alarm system applications that require multiple I/O points of various types.

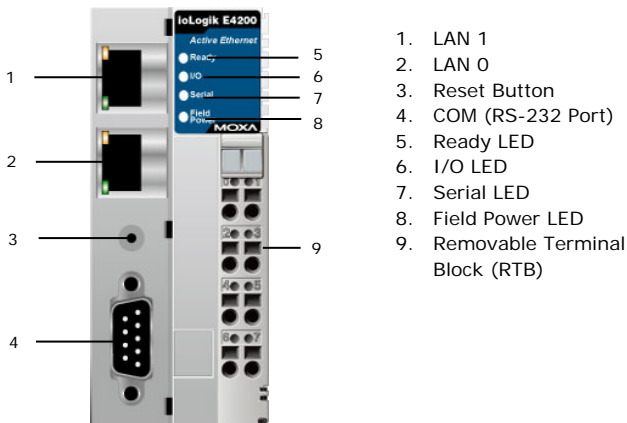


## Package Checklist

Moxa's ioLogik E4200 is shipped with the following items. If any of these items are missing or damaged, please contact your customer service representative for assistance.


- 1 ioLogik E4200 Active Ethernet Network Adaptor.
- Quick installation guide (printed).
- End Module Cover.

## Installing the I/O Module on a DIN-Rail

**Step 1:** Align the I/O module side by side with the network adaptor, making sure that the upper and lower rails are hooked together.

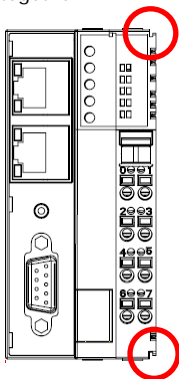


**Step 2:** Align the I/O module side by side with the network module and then push the I/O module until it touches the DIN-rail. Next, apply more force until the module clips to the DIN-rail.

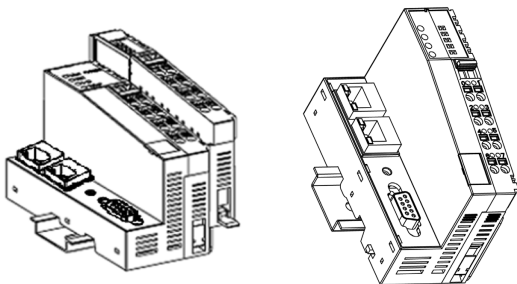


## Removing the I/O Module from the DIN-Rail

**Step1:** Use your finger or a screw driver to pull down the tab on the lower part of the module.

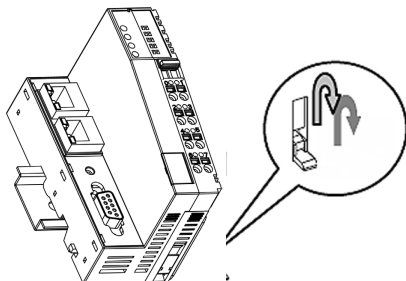


**Step 2:** While still holding down the tab, pull out the Module.



## Remove the RTB from the I/O module


Pull out the plastic belt from the RTB, and then apply more force until the I/O module is pulled away from the I/O module.

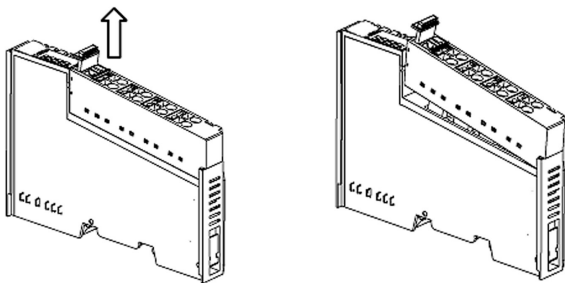

## Installing the RTB onto the I/O Module


**Step 1:** Hook the bottom end of the RTB to the I/O module.

**Step 2:** Push down the RTB until it fits snugly on the I/O module, and then push in the plastic belt.




## Installing the System Power Module

The system power expansion module is designed to provide extra power when additional I/O expansion modules are connected. Each iologik E4200 can provide 1.5A @ 5 VDC. If you require more power for your installed I/O expansion modules, you will need to use an M-7001 module. However, please note that the M-7001 can only provide 1A @ 5 VDC.

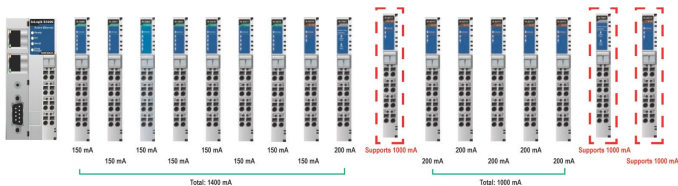


# Installing the Field Power Module

The field power distributor is designed to isolate different field voltages. For example, before you connect a 110 VDC or 220 VAC AC-Digital Input module to a 24 VDC DI/O module, you will need an M-7002 field power distributor.

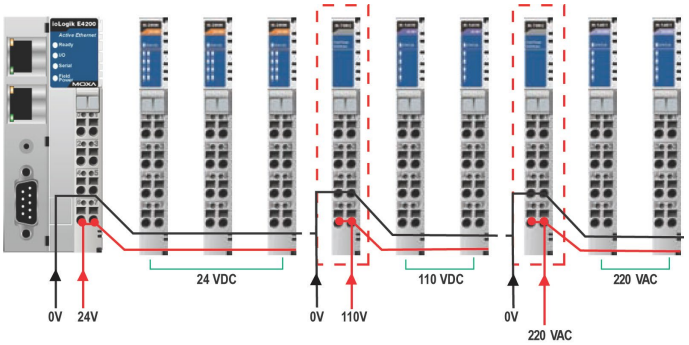

# Connecting the Power System

Two 24 VDC power sources are required to power the ioLogik E4200. One 24 VDC power input is for system power, and the other 24 VDC power input is for the field I/O. For field installation, system power and field power are provided by different power supply systems.

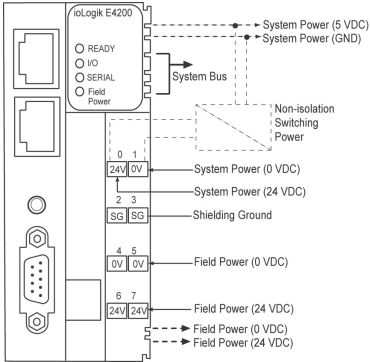

### System power:

24 VDC nominal,  
11 to 28.8 VDC

### Power dissipation:

60 mA @ 24 VDC

### Current for I/O module:

1.5A @ 5 VDC

### Field power :

11 to 28.8 VDC

### Max. current for field power

contact: DC 10A Max.

### I/O Cable Gauge:

AWG14 to AWG28

## Supported Modules

### DC-Digital Input Modules

M-1800	8 digital inputs, sink, 24 VDC, removable terminal block
M-1801	8 digital inputs, source, 24 VDC, removable terminal block
M-1600	16 digital inputs, sink, 24 VDC, 20-pin header
M-1601	16 digital inputs, source, 24 VDC, 20-pin header

### AC-Digital Input Modules

M-1450	4 digital inputs, 110 VAC, removable terminal block
M-1451	4 digital inputs, 220 VAC, removable terminal block

### Digital Output Modules

M-2800	8 digital outputs, sink, 24 VDC, 0.5A, removable terminal block
M-2801	8 digital outputs, source, 24 VDC, 0.5A, removable terminal block
M-2600	16 digital outputs, sink, 24 VDC, 0.3A, 20-pin header
M-2601	16 digital outputs, sink, 24 VDC, 0.3A, 20-pin header

### Relay Output Modules

M-2450	4 Relay outputs, Form A (N.O.), 2A, removable terminal block
--------	--

### Analog Input Modules

M-3802	8 analog inputs, 4 to 20 mA, 12-bit, removable terminal block
M-3810	8 analog inputs, 0 to 10V, 12-bit, removable terminal block

### Temperature Input Modules

M-6200	2 analog inputs, RTD, removable terminal block
M-6201	2 analog inputs, thermocouple, removable terminal block

### Analog Output Modules

M-4402	4 analog outputs, 4 to 20 mA, 12-bit, removable terminal block
M-4410	4 analog outputs, 0 to 10V, 12-bit, removable terminal block

### System Modules

M-7001	System expansion power supply, 1.0 A (5 VDC)
M-7002	Field power distributor, 10 A (24/48 VDC, 110/220 VAC)
M-7806	Potential distributor, 8 ch, 4 ch / 24 VDC, 4ch / 0 VDC

## Accessories




### TB 1600 DIN-rail mounting screw terminal module with 20-pin connector

- 20 pins, one-to-one assignment
- Connector pitch: 3.81 mm
- DIN-rail mounting type
- Dimensions (W x L x H): 77.5 x 67.5 x 51 mm
- RoHS compliant



### 20-pin to 20-pin flat cable

- Connecting between TB 1600 and ioLogik 4000 series
- Length: 50 cm
- Number of pins: 20



### M-8001-PK Removable terminal block

- Terminal block for ioLogik 4000 series
- Packaging: 9 pcs in one box



### M-8003-PK Marker with 0 to 9 numbering

### M-8004-PK Blank marker

- Marker for ioLogik 4000 series
- Packaging: 100 pcs in one box

## How to Download the Software

**Step 1:** Click on the following link to open the Support & Downloads search tool:

[http://www.moxa.com/support/support\\_home.aspx?isSearchShow=1](http://www.moxa.com/support/support_home.aspx?isSearchShow=1)

**Step 2:** Type the model name in the search box or select a product from the drop down box and then click **Search**.

### Support & Downloads

A screenshot of a web search interface. It features a search bar with the text "2512-HSPA" and a blue "Search" button. Below the search bar, there is a blue "OR" label and a dropdown menu with the text "select product". The background is a light grey with a faint magnifying glass icon.

Please choose a model :

• [ioLogik 2512-HSPA](#)

**Step 3:** Click the **Software Packages** link to download the latest software for the product.

## ioLogik 2512-HSPA

### Documentation

- Datasheets
- Manuals

### Software

- Firmware
- Libraries
- **Software Packages**
- Utilities

### Other

- Product Page